

SEDE

Via Martelli, 26 - 40138 Bologna
Tel. (051) 534015 - Fax. (051) 530085

CERTI.CER.

LABORATORIO DI ZONA

Via Valle d'Aosta, 1 - 41049 Sassuolo
Tel. e Fax. (0536) 802154

Part. IVA 0094778-0375

Bologna, 24/04/06

Spett. le
CERAMIKA NOWA GALA SA
Ul. CERAMICZNA, 1
26-200 KOŃSKIE
POLAND

TEST LABORATORY

TEST REPORT N° 3955/06

concerning ceramic tiles according to UNI EN 14411 (ISO 13006)

Requested by:	CERAMIKA NOWA GALA SA Ul. CERAMICZNA, 1 26-200 KOŃSKIE POLAND
On (date):	09/03/06
For the sample marked:	"Serie QZ struktura".

The results reported relate only to the samples tested.

No responsibility is taken for the accuracy of the sampling unless it is done under our supervision.

The reproduction of this test report is only authorized in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction.

This test report consists of 3 pages this cover included.



Consorzio universitario per la gestione del
«Centro di ricerca e sperimentazione per
l'industria ceramica».
D.P.R. 10-4-1978 n. 806
(G.U. 20-12-1978 n. 353)

Laboratorio autorizzato ad effettuare il
servizio di rilevamento dell'inquinamento
atmosfera.
Decreto MINISTERO SANITÀ 10-8-1974
(G.U. 14-9-1974 n. 240)

Laboratorio iscritto nell'albo dei «Laboratori Esterni
Pubblici e Privati Altamente Qualificati».
Decreto MINISTERO RICERCA SCIENTIFICA 6-6-1983
(G.U. 6-7-1983 n. 183)

Membro ASTM
American Society for
Testing and Materials.

Description of the sample:

Unglazed ceramic tiles 30 x 30 x 0,9 cm marked
"Serie QZ struttura".

Manufacturer: CERAMIKA NOWA GALA SA

Sampling details:

- Where: -----
- Date: -----
- By whom: CUSTOMER
- How (methods): -----

DATE OF RECEIVAL IN LABORATORY: 10/04/06

TESTS PERFORMED:


		Date of starting	Date of ending
<input checked="" type="checkbox"/>	DIN 51097 Slip resistance	14/04/06	21/04/06

DIN 51097 - Slip resistance

OPERATIVE CONDITIONS

- Size of the tested surface (m) 0.50 x 1.50
- Joint width (mm): 2
- Grout: Cement mortar

Fixing scheme

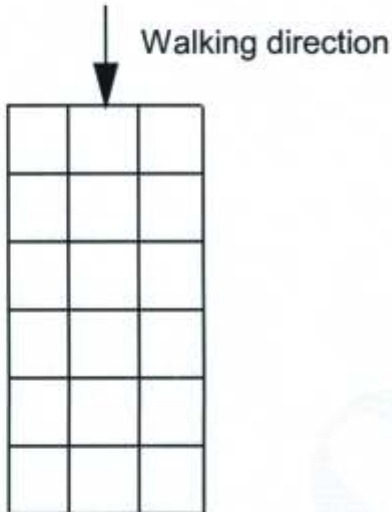

RESULTS

Average slip angle:
Application range:

> 33°
A+B+C



Prof. Ing. Giorgio Timellini
DIRECTOR